

**On Site Sewage Facility Information Sheet
FORT BEND COUNTY**

Owner To Fill In:

Date: _____

Name: _____

Site Address: _____ **City:** _____ **Zip:** _____

Current Mail Add.: _____ **City:** _____ **Zip:** _____

Home Ph#: _____ **Work Ph#:** _____

Cell Ph#: _____ **Fax Ph#:** _____

Payment Option: Personal Check: _____ **Cash:** _____ **Lender:** _____
Visa or MasterCard (add 4% to bid price): _____

To be filled out by person meeting owner.

Harness: Flex: _____ **Post:** _____ **What length:** _____

4" pipe needed: _____ **1" or 1-1/4" pipe needed:** _____

Sign in yard: _____ **Map made:** _____ **Job flagged: Y / N**

Pre-site Scheduled: Y / N

Lines to cross: telephone, gas, electrical, etc. _____

Notes:

Customer instructions for completing septic system paperwork.

Pg. 1 – Fort Bend County Application - Fill out information 1-7 only.

Pg. 2 – Fort Bend County Application - Leave blank.

Pg. 3 – Norweco Contract - Customer signature & Date required

Pg. 4 – Affidavit - Sign and Print name of property owner.

NOTE: A copy of your property survey needs to be returned with papers, preferably a plot plan.

Pg. 5 – Installation Contract - Read notes, Sign and Date.

NOTE: Duplicate copy is for your records.

Please return all originals to our office. The brochure and system design are for you to keep.

If you have any questions or require additional information please feel free to call us anytime at 1-800-841-3447.

CUSTOMER CHECKLIST:

- ___ 1. Survey of Property or Plot Plan
 - ___ 2. Tax Receipt or Deed for Legal Description and Proof of ownership
 - ___ 3. Well Log (if requested)
 - ___ 4. Correct 911 Address (Required for Floodplain)
 - ___ 5. Floodplain Signoff
-

BELOW FOR OFFICE USE ONLY.

Before the application is submitted to the D.R. the following is needed.

- ___ 1. Survey of property.
- ___ 2. Legal description is to be filled out on all paperwork.
- ___ 3. Affidavit to the public filed in the county clerk's office
- ___ 4. Well log.
- ___ 5. Maintenance contract.
- ___ 6. Check for permit.
- ___ 7. Site Evaluation.
- ___ 8. Engineered design
- ___ 9. Proposal Sheet
- ___ 10. Flood Plain Signoff.



FORT BEND COUNTY ENVIRONMENTAL HEALTH ON-SITE SEWERAGE FACILITY PERMIT APPLICATION

4520 Reading Road, Rosenberg, Texas 77471

281-342-7469

Key Map _____
Precinct _____

Permit Track # _____

EHD# _____ Office use

1. PROPERTY OWNER: _____
(LAST) (FIRST) (MIDDLE)

2. MAILING ADDRESS: _____
(STREET/P.O. BOX) (CITY/STATE) (ZIP)

3. TELEPHONE NO. HOME: () _____ WORK: () _____

4. SITE ADDRESS: _____
(STREET) (CITY) (ZIP)

5. PROPERTY DESCRIPTION: Lot _____ Block _____ Sec _____ Subdivision _____

Survey: _____ **OR** _____ Abstract _____ Vol. _____ Page _____

6. LOT SIZE: _____ Acres ***PROPERTY SURVEY MUST BE ATTACHED FOR ALL PROPERTIES.**

7. SOURCE OF WATER: _____ Private Well _____ Public Water Supply _____
(NAME OF WELL DRILLER OR SUPPLIER)

8. SINGLE FAMILY RESIDENCE: # Of Bedrooms _____ Living Area (Sq. Ft.) _____
Water Saving Devices Installed? Yes _____ No _____

9. COMMERCIAL/INSTITUTIONAL (including multi-family residences) TYPE: _____
NUMBER OF EMPLOYEES/OCCUPANTS/UNITS: _____ Square Footage _____

11. DESIGNER: _____ Registration # _____ Phone # _____

12. INSTALLER: _____ Registration # _____ Phone # _____

13. SITE EVALUATOR: _____ Registration # _____ Phone # _____

16. OWNER'S AGENT: _____
(Authorization to Submit the Permit Application & the Planning Materials to the Permitting Authority)

This application is valid for one (1) year after dated receipt of payment.

Authorization is hereby given to Fort Bend County to enter upon the above described property for the purpose of inspecting sewage facilities for any reason consistent with the Texas Health and Safety Code.

I HEREBY CERTIFY THAT ALL STATEMENTS IN THIS DOCUMENT ARE TRUE AND CORRECT TO THE BEST OF MY KNOWLEDGE AND BELIEF.

Property Owner Signature: _____ Date: _____

Reviewed By: _____ Date: _____
Fort Bend County Designated Representative

THE COUNTY OF FORT BEND
STATE OF TEXAS

**AFFIDAVIT TO THE PUBLIC
CERTIFICATION OF OSSF REQUIRING MAINTENANCE**

According to Texas Commission on Environmental Quality Rules for On-Site Sewage Facilities, this document is filed in the Deed Records of Fort Bend County, Texas.

I

The Texas Health and Safety Code, Chapter 366 authorizes the Texas Commission on Environmental Quality (commission) to regulate on-site sewage facilities (OSSFs). Additionally, the Texas Water Code (TWC), §5.012 and §5.013, gives the commission primary responsibility for implementing the laws of the State of Texas relating to water and adopting rules necessary to carry out its powers and duties under the TWC. The commission, under the authority of the TWC and Texas Health and Safety Code, requires owner's to provide notice to the public that certain types of OSSFs are located on specific pieces of property. To achieve this notice, the commission requires a recorded affidavit. Additionally, the owner must provide proof of the recording to the OSSF permitting authority. This recorded affidavit is not a representation or warranty by the commission of the suitability of this OSSF, nor does it constitute any guarantee by the commission that the appropriate OSSF was installed.

II

An OSSF requiring a continuous service policy, according to 30 Texas Administrative Code §285.91(12) will be installed on the property(ies) described and that this recorded affidavit affirms that the property(ies) will not be sold separately, subdivided, or re-platted without prior approval from the Fort Bend County Environmental Health Department.

1) Legal Description: _____

2) Legal Description: _____

_____ Check here if additional properties are involved. Provide additional legal descriptions on a separate sheet labeled "Attachment A".

Physical address(es): _____

The property is owned by:

Owner: _____

The OSSF shall be covered by a continuous service policy. All service on this OSSF must be performed by an approved maintenance provider, and a signed continuous service policy must be submitted to Fort Bend County within 30 days after the property has been transferred.

Upon any sale or transfer of the above-described property, the permit for the OSSF shall be transferred to the buyer or new owner. A copy of the planning materials for the OSSF can be obtained from Fort Bend County.

WITNESS BY HAND(S) ON THIS _____ DAY OF _____, _____.

(Owner(s) signature(s))

SWORN TO AND SUBSCRIBED BEFORE ME ON THIS _____ DAY OF _____, _____.

Notary Public, State of Texas

Revised September 2008

Hurt's Wastewater Management, Ltd.
P.O. Box 662 – Ganado, TX 77962
(800) 841-3447- Fax (361) 771-3452

Installation Contract

Installation Prices: Include appropriate trash and pump tank sizes.

600 gpd Norweco Aerobic Unit w/ 890 gal. pump tank 600 gpd w/ drip irrigation
750 / 1000 / 1250 / 1500 gpd Norweco Aerobic Unit

Site evaluation / Design / Permit: Total _____ John Hurt _____
(Good for 60 days)

- Note: **This is a dry bid only.** In the event the job site is not accessible due to the weather conditions, there will be an additional charge to mud the system in. Either use of track hoe to dig and set tanks or use of mats to drive truck in. Additional amount charged subject to severity of location.
- Note: The above prices are based on the home having one stub out and the tanks being located within 20' of the stub out. If there is more than one stub out, there will be an additional charge \$50.00 per stub out plus \$5.00 per foot to connect the pipe. In the event of multiple stub outs and the stub out being positioned such as to require the installation of a lift station, there will be additional charges.
- Note: An additional charge of \$250.00 for Risers will be added if stub outs are more than 24"
- Note: **Owners electrician is responsible for bringing 30amp 110 circuit (for 600 gpd only) within 5' of stub out.** Hurt's will provide 15' of electrical, however extra wire and conduit will cost \$6.00 per foot.
- Note: **Excess dirt will be left stockpiled on job site.**
(Hurt's not responsible for damaging any unmarked underground lines)
- Note: **Homeowner or Builder** is responsible for water supply to fill tanks, as well as the removal and/or replacement of fences or structures.
- Note: **Hurt's is not responsible for back filling around tanks after dirt settles.** One load of sand provided by Hurt's to be used for 4" pad under tanks and filling around 4" pipe from house.
- **Payment in full required day of installation. Contract is with Hurt's and homeowner. If payment is coming from the builder the homeowner is responsible for making sure Hurt's receives that payment.**
Visa / MasterCard / accepted at Hurt's office only. If used there will be an additional charge.

Customer Signature: _____ Date Required: _____

Hurt's Wastewater Management, Ltd.
P.O. Box 662 – Ganado, TX 77962
(800) 841-3447- Fax (361) 771-3452

Installation Contract

Installation Prices: Include appropriate trash and pump tank sizes.

600 gpd Norweco Aerobic Unit w/ 890 gal. pump tank 600 gpd w/ drip irrigation
750 / 1000 / 1250 / 1500 gpd Norweco Aerobic Unit

Site evaluation / Design / Permit: Total _____ John Hurt _____
(Good for 60 days)

- Note: **This is a dry bid only.** In the event the job site is not accessible due to the weather conditions, there will be an additional charge to mud the system in. Either use of track hoe to dig and set tanks or use of mats to drive truck in. Additional amount charged subject to severity of location.
- Note: The above prices are based on the home having one stub out and the tanks being located within 20' of the stub out. If there is more than one stub out, there will be an additional charge \$50.00 per stub out plus \$5.00 per foot to connect the pipe. In the event of multiple stub outs and the stub out being positioned such as to require the installation of a lift station, there will be additional charges.
- Note: An additional charge of \$250.00 for Risers will be added if stub outs are more than 24"
- Note: **Owners electrician is responsible for bringing 30amp 110 circuit (for 600 gpd only) within 5' of stub out.** Hurt's will provide 15' of electrical, however extra wire and conduit will cost \$6.00 per foot.
- Note: **Excess dirt will be left stockpiled on job site.**
(Hurt's not responsible for damaging any unmarked underground lines)
- Note: **Homeowner or Builder** is responsible for water supply to fill tanks, as well as the removal and/or replacement of fences or structures.
- Note: **Hurt's is not responsible for back filling around tanks after dirt settles.** One load of sand provided by Hurt's to be used for 4" pad under tanks and filling around 4" pipe from house.
- **Payment in full required day of installation. Contract is with Hurt's and homeowner. If payment is coming from the builder the homeowner is responsible for making sure Hurt's receives that payment.**
Visa / MasterCard / accepted at Hurt's office only. If used there will be an additional charge.

Customer Signature: _____ Date Required: _____


HURT'S WASTEWATER MANAGEMENT, LTD.

John P. Hurt – Norweco Certified Technician No. 5208134

P.O. Box 662 – Ganado, TX 77962

Bus: (800) 841-3447 - Fax: (361) 771-3452

www.hurtswastewater.com

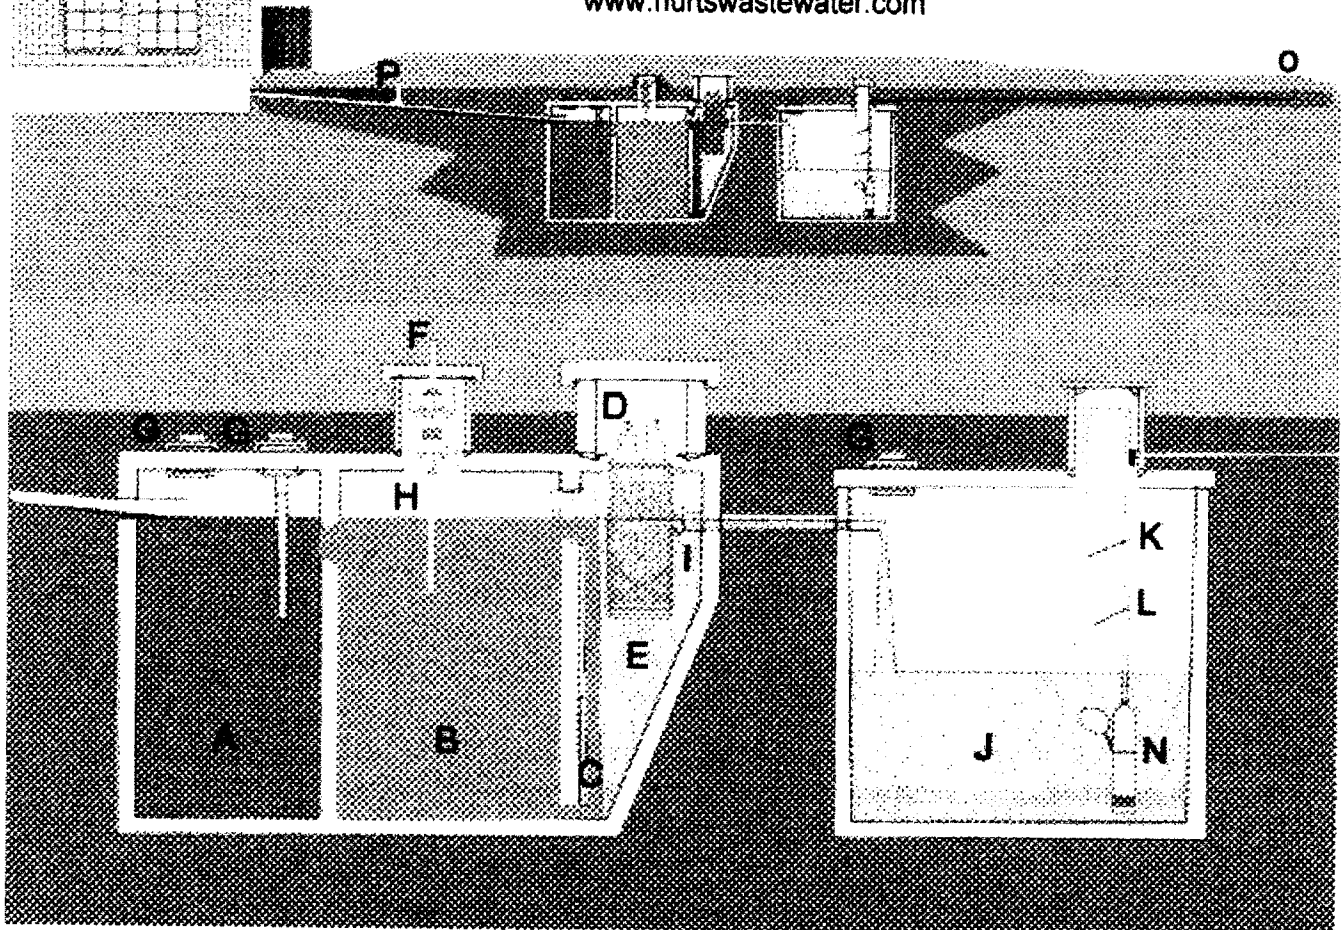

A – Pretreatment Chamber

B – Extended Aeration Chamber

C – Sludge Return

D – Chlorination System

E – Clarification Chamber

F – Fresh Air Vent

G – Inspection Cover

H – Aerator

I – Filter Assembly

J – Pump Chamber

K – Alarm Float

L – Override Float

M – On/Off Float

N - Pump

O - Sprinkler

P – Clean Out

NOTE: Total System Capacity – 1,300 Gallons
Total Capacity – 889 Gallons

RATED CAPACITY: 600 Gallons Per Day